



**DES MOINES WATER WORKS**  
**Board of Water Works Trustees**

Agenda Item No. III-E  
 Meeting Date: November 28, 2017  
 Chairperson's Signature  Yes  No

**AGENDA ITEM FORM**

**SUBJECT: Acceptance of McMullen Water Treatment Plant Chemical Feed Line Relocation**

**SUMMARY:**

- At the January 2017 Board meeting, the Board of Water Works Trustees awarded a contract to Synergy Contracting, LLC, in the amount of \$236,592.72, for the McMullen Water Treatment Plant Chemical Feed Line Relocation project.
- All work associated with this contract has been satisfactorily completed.
- The project included one change order for an increase of \$565.00 in contract price. Change Order No. 1 was for the purpose of installing additional conduits for supplemental sensor wiring.
- The final contract price for the McMullen Water Treatment Plant Chemical Feed Line Relocation is \$240,600.60. The final price is \$4,007.88 more than the original contract amount due to Change Order No. 1 in the amount of \$565.00 and increased lengths of chemical line carrier piping as the installation layout was adjusted for field conditions.

**FISCAL IMPACT:**

Funds for this project will come from the McMullen Treatment Plant – Sodium Hypochlorite, Fluoride, and Polyphosphate Transfer Lines and the Facilities Management – Polyphosphate Feed and Filter Building Valve Isolation budgets. The budgeted funds carried over from 2016 to 2017 for this project are \$241,500.00.

**RECOMMENDED ACTION:**


Accept the McMullen Water Treatment Plant Chemical Feed Line Relocation project, completed by Synergy Contracting, LLC, in the amount of \$240,600.60.

**BOARD REQUIRED ACTION:**

Motion to accept the McMullen Water Treatment Plant Chemical Feed Line Relocation project, completed by Synergy Contracting, LLC, in the amount of \$240,600.60.

_____ / _____ Donald K. Staley, P.E. (date) Engineering Supervisor	_____ / _____ Danny J. Klopfer, P.E. (date) Engineering Services Manager	_____ / _____ William G. Stowe (date) CEO and General Manager
--	--	---

Attachments: Site Map

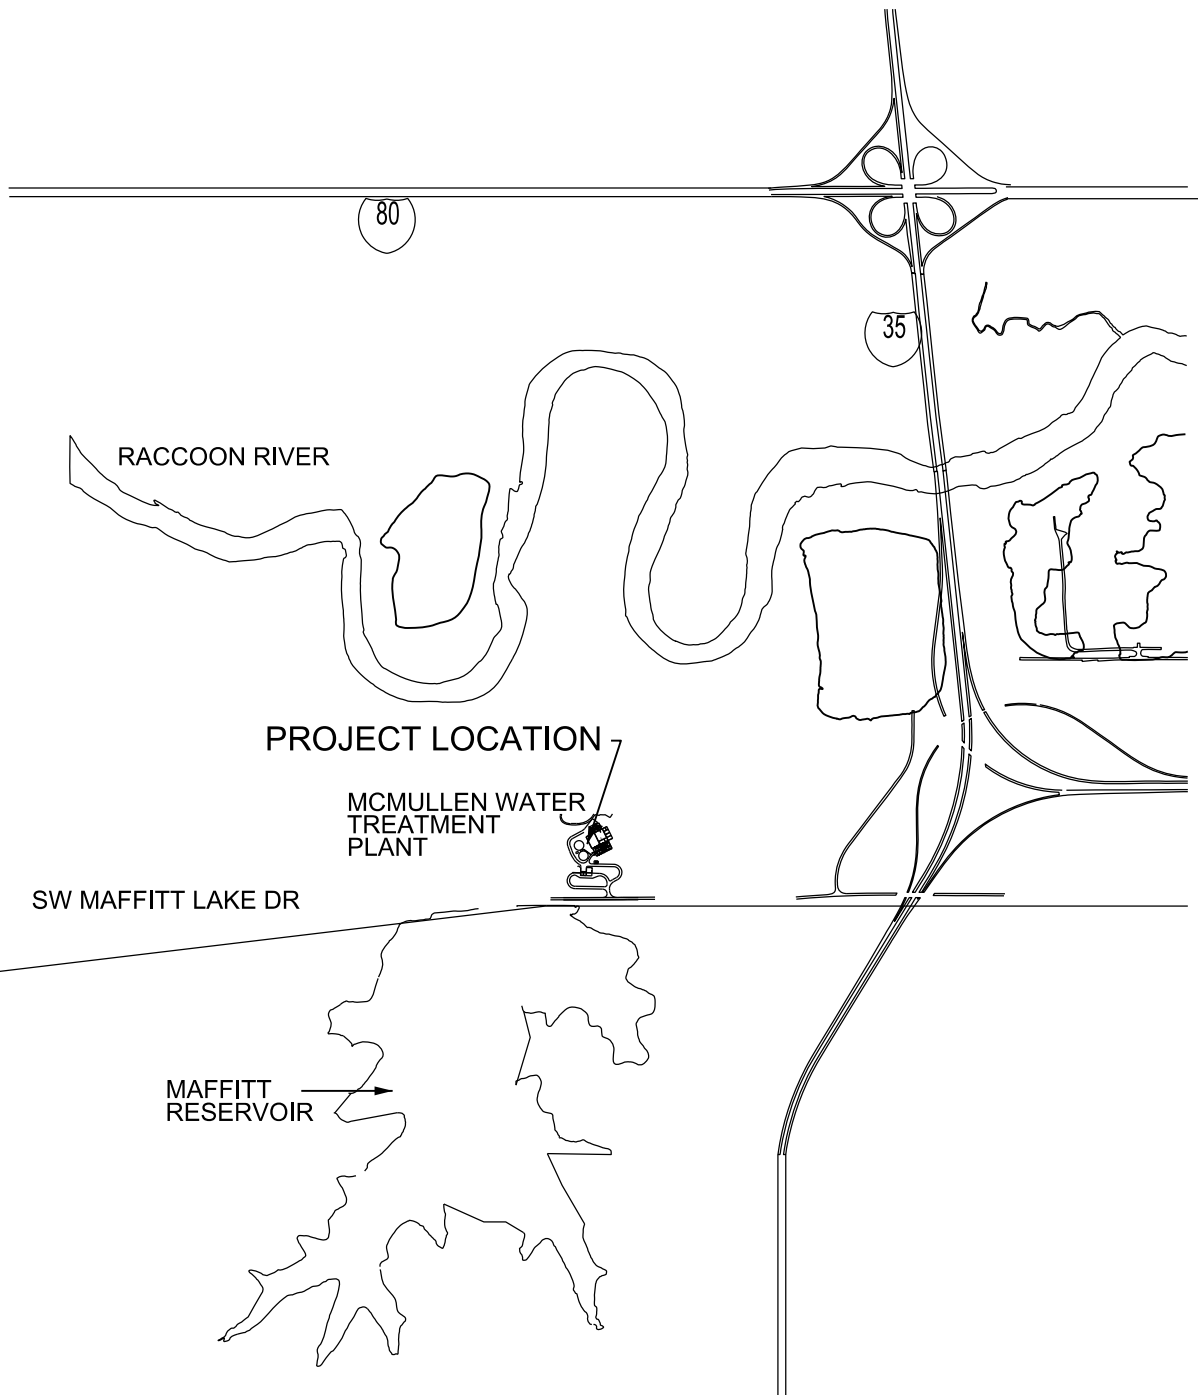

NOT TO SCALE